


# I-Series Plus Heat-Only (Solo) Boiler

## Models: IP060S, IP090S, IP120S, IP150S





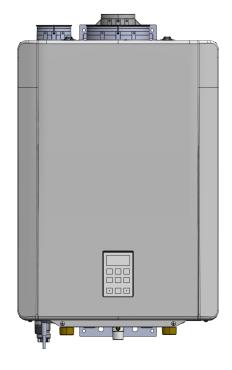





CERTIFIED TO ANSI Z21.13 — CSA 4.9


Models	IP060S, IP090S, IP120S, IP150S	
AFUE	Up to 96%	
Appliance	Wall-Mounted, Gas-Fired Heat-Only (Solo) Boiler	
Installation	Indoor	
Gas Types	Natural Gas (or Propane with field conversion)	
Standard Features	<ul> <li>Outdoor Reset Control System with Sensor</li> <li>Modulating Wire Mesh Burner</li> <li>Stainless Steel Water Tube Condensing Heat Exchanger</li> <li>Direct Vent Sealed Combustion</li> <li>Approved for Room and Closet Installations</li> </ul>	
Included with Purchase	<ul> <li>Condensing Gas Boile</li> <li>Wall Mounting Bracket</li> <li>CH Pressure Relief Val</li> <li>Outdoor Temperature</li> <li>Vent Top with Integrate Concentric Vent Adap</li> <li>Documentation: Install Manual, User Manual</li> </ul>	ve (30 PSI) Sensor ed 2 in. PVC or 3 in. x 5 in. ter
Optional Accessories	Primary-Secondary Heating Kit (PN: 807000213), Condensate Neutralizer (PN: 804000074), ScaleCutter (PN: 103000038), and ScaleCutter Refill Cartridge (PN: 103000039).	
Venting Options	<ul> <li>Direct Vent (Concentric and Twin Pipe)</li> <li>Room Air</li> <li>Ubbink Flex Vent</li> <li>Materials: Polypropylene, Stainless Steel, PVC, CPVC</li> <li>Refer to the Boiler Installation and Operation Manual for approved venting.</li> </ul>	
·	alent Vent Lengths: win Pipe, and Room Air:	
Vent Sizes	<ul><li>2 in. PVC</li><li>2 in. (60 mm) PP</li><li>2 in. x 4 in. Concentric</li></ul>	<ul><li>3 in. PVC</li><li>3 in. (80 mm) PP</li><li>3 in. x 5 in. Concentric</li></ul>
	75 ft (23 m)	160 ft (49 m)


50 ft (15 m)

For detailed venting information, refer to the Boiler Installation and

Vent Lengths

Operation Manual.

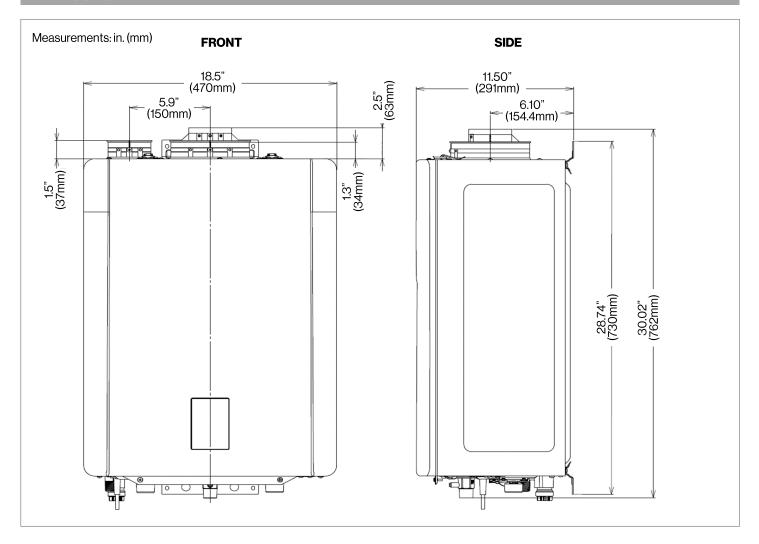


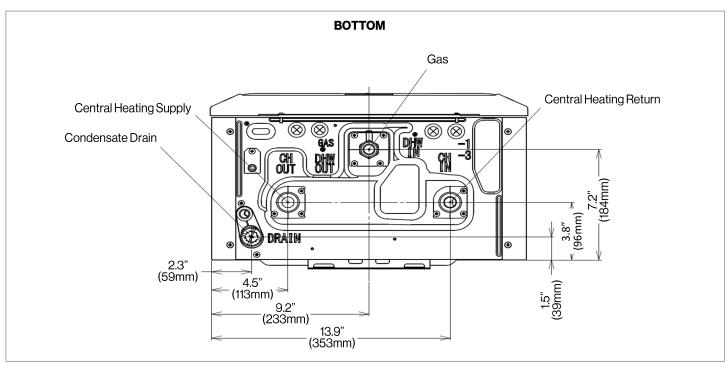

#### TECHNICAL SPECIFICATIONS **IP060S IP090S IP120S IP150S** Model Unit 18.5 in. x 26.4 in. x 11.45 in. (471 mm x 671 mm x 290 mm) Dimensions - w, h, d Shipping 20.9 in. x 33.5 in. x 14.6 in. (532 mm x 852 mm x 370 mm) Unit 62.6 lb (28.4 kg) 64.8 lb (29.4 kg) Weight 69.1 lb (31.4 kg) 71.3 lb (32.4 kg) Shipping **IgnitionSystem** Direct Electronic Ignition Heat Exchanger Surface Area 9.3 sa ft 10.9 sa ft Minimum 15.000 Gas Consumption (Btu/hr) Maximum 60,000 90,000 120,000 150,000 Heating Capacity (MBH) 56 83 110 138 Temperature Setting (CH) (Min-Max) 86°F-180°F (30°C-82°C) Water Content 0.75 gal 0.88 gal Minimum: 13 PSI (90 kPa) Maximum: 45 PSI (310 kPa) CH Recommended: 17 - 26 PSI (117 - 180 kPa) Water Supply Pressure Pressure Relief 30 PSI (207 kPa) **Valve** Sound Level 40 dB(A) 42 dB(A) Normal (CH) 36 W 53 W 50 W 50 W Standby 8 W Electrical Data Max Current 14 Amps Fuse 10 Amps x1, 4 Amps x5 Turndown Ratio (TDR) 4.0:1 6.0:1 8.0:1 10.0:1 **AFUE** 95.5% 96.0% Natural Gas 3.5 in. - 10.5 in. W.C. (0.87 - 2.61 kPa) Gas Supply Pressure1 Propane 8.0 in. - 13.5 in. W.C. (1.99 - 3.36 kPa) Electric Connections AC 120 Volts, 60 Hz

ANSI Z21.13, CSA 4.9, ASME

Certifications

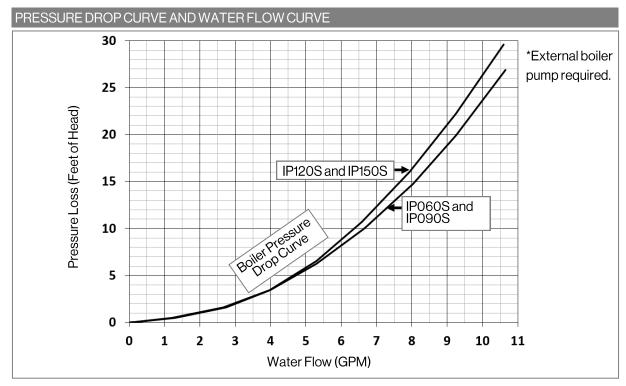

#### **FEATURES**

#### ■ Faster, Easier Installation

- Compact & lightweight design
- Convenient mounting bracket
- NPT threads for connection points
- More flexible venting options
- Simplified parameters for commissioning and setup

#### Clearances

- Top: 2 in. (51 mm)\*
- Bottom: 12 in. (305 mm)
- Front: 6 in. (152 mm)\*\*
- Back: 0 in.
- Sides: 2 in. (51 mm)
- Vent: 0 in.
- \* 0 in. from vent components. 6 in. (152 mm) for closet installations.
- \*\* Clearance for servicing is 24 in. (610 mm) in front of boiler.

#### Warranty

#### Residential:

- Heat Exchanger: 12 Years
- All Other Parts/ Components: 5 Years
- -Labor:1Year

#### Commercial:

- Heat Exchanger: 5 Years
- All Other Parts/ Components: 5 Years
- Labor: 1 Year

#### Important

If the boiler is to be installed in a system that has multiple zones, a Closely Spaced Tee/Manifold Kit

### (PN: 807000213) is

recommended to be installed.

CH = Central Heating PRV = Pressure Relief Valve

©2024 Rinnai America Corporation. Rinnai America Corporation continually updates materials, and as such, content is subject to change without notice. Local, state, provincial federal and national fuel gas codes must be adhered to prior to and upon installation.

<sup>&</sup>lt;sup>1</sup>Maximum gas supply pressure must not exceed the value specified by the manufacturer.