Date:		For:	File	Resubmit
PO No.:			Approval	Other
Architect:	GC:			
Engr:	Mech	ո։		
Rep:				

(Project Manager)



### LDN097HV4

Job Name/Location:

Multi F Ceiling-Concealed Low-Static Duct

#### Performance:

(Company)

Nominal Cooling Capacity (Btu/h)	9,000
Nominal Heating Capacity (Btu/h)	10,400

Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

#### **Electrical:**

Power Supply (V¹/Hz/Ø)	208-230/60/1
Rated Amps (A)	0.40

#### Piping:

Installed Liquid Pipe (in., O.D.)	ø1/4
Installed Vapor Pipe (in., O.D.)	ø3/8
Liquid Connection (in., O.D.)	ø1/4
Vapor Connection (in., O.D.)	ø3/8
Drain (in., O.D. / I.D.)	1-1/4, 1
Temperature Sensor	Thermistor

### **Controls Features:**

- Two thermistor control
- Auto operation
- Auto restart
- Control lock function
- Drain pump
- Group control
- Inverter (variable speed fan)
- Compatible with accessory Wi-Fi module12
- Compatible with applicable Single Zone Outdoor Units (see single zone literature for matching system details)

#### **Optional Accessories:**

- ☐ MultiSITE™ CRC1 Controller PREMTBVC0
- ☐ MultiSITE™ CRC1+ Controller PREMTBVC1
- ☐ Simple Remote Controller PREMTC00U
- ☐ Premium Remote Controller PREMTA000
- ☐ AC Smart Premium PQCSW421E0A
- ☐ ACP Premium PQCPC22A1
- ☐ ACP Standard PQCPC22N1
- ☐ LonWorks Gateway PQNFB16A1
- ☐ BACnet Gateway PQNFB17C1
- ☐ Remote Temperature Button Sensor ZRTBS01
- ☐ Simple Dry Contact (1 contact, 24 VAC external power) PDRYCB100
- ☐ Dry Contact for Third Party Thermostat PDRYCB300
- ☐ Dry Contact for Economizer PDRYCB400
- ☐ Auxiliary Heater Kit PRARH1
- ☐ Wi-Fi Module PWFMDD200

# **Entering Mixed Air:**

Tag #:

Coo	ling (°F DB)	57 ~ 77
Hea	ting (°F WB)	59 ~ 81

#### **Unit Data:**

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (H/M/L) dB(A) <sup>2</sup>	30 / 26 / 23
Primary Filter	Washable Pre-filter
Net Weight (lbs.)	39
Shipping Weight (lbs.)	46

#### Fan:

bo
1
ect
94
10
00
20
) 1

#### Notes:

- Acceptable operating voltage: 187V-253V.
   Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
- 3. Adjust fan speed to correct for static pressure increases when using field-supplied air filter.

- 5. Adjust lain special countries and pressure increases with A. At factory fan speed setting.
  5. Air flow rate (CFM) at high speed.
  6. See Engineering Manual for sensible and latent capacities.
- 6. See Eighteeting Waltuarion Sensitive and item capacities.
  7. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
  8. Power wiring cable size must comply with the applicable local and national code.
  9. The indoor unit comes with a dry helium charge.
  10. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 105%.
  11 Must follow installation instructions in the applicable IG installation manual

- 11. Must follow installation instructions in the applicable LG installation manual. 12. 9/12MBH models manufactured June 2018 and after; LDN187HV4 upon launch








## LDN097HV4

Multi F Ceiling-Concealed Low-Static Duct 9.000 Btu/h



Tag No.: \_\_\_\_\_\_

Date: \_\_\_\_\_

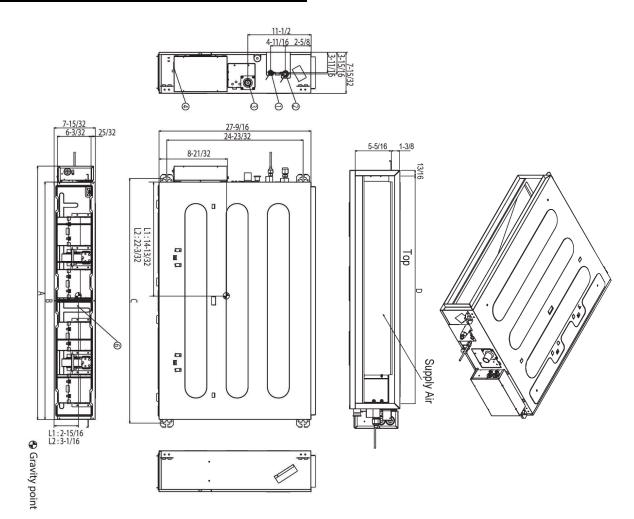

	5 Air di	4 Power supp	3 Drain pipe	2 Gas pipe	1 Liquid pipe	umber Name	
Air suction	Air discharge	Power supply connection	Drain pipe connection	Gas pipe connection	Liquid pipe connection	ne	
						Descripition	(Unit: inch)

LDN127HV4 LDN187HV4	LDN097HV4	Model Number
38-11/32	30-15/32	А
35-7/16	27-9/16	В
35-7/16 36-23/32 33-27/32	27-9/16 28-27/32 25-31/32	0
33-27/32	25-31/32	D

(unit: inch)